


Permanent ID Information:

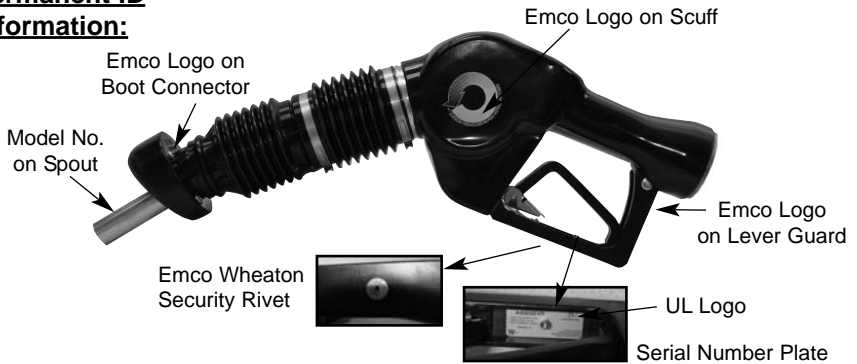

INSTALLATION INSTRUCTIONS

Service Tools Required:


- 2" Crows Foot
- Torque Wrench w/ 50 ft-lbs Setting
- 1 7/8" Crows Foot
- Pipe Wrench w/ Flat Jaws
- Gasoline Approved Container
- Petroleum Jelly or Other Suitable Lubricant

CAUTION:

1. Always barricade work area to keep pedestrians and vehicles from accessing the dispenser.
2. Always use a gasoline approved container or test can when performing any type of preventive maintenance.
3. Before attempting to install, remove or service the A4005EVR nozzle, turn off and tag out power to the corresponding dispenser.
4. Before attempting to install, remove or service the A4005EVR nozzle, close the emergency impact valves located inside the base of the dispenser. Relieve the line pressure and standing fuel through the nozzle spout into a gasoline approved container by compressing the bellows and squeezing the lever.


IMPORTANT: Failure to perform cautions 3 and 4 may result in a hazardous gasoline spill, damage to equipment, personal injury and/or death.

Pre-Inspection:

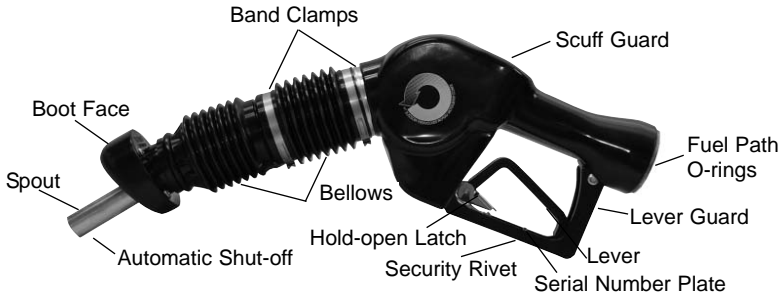

1. Carefully unpack and remove the A4005EVR nozzle from the shipping container. Evaluate the following components for damage: scuff guard, lever guard, lever, hold open latch, serial number plate, security rivet, bellows, band clamps, boot face and spout.
2. Verify the automatic shutoff located at the end of the spout. The vent hole must be free and clear of all debris.
3. Verify the fuel path o-rings located at the hose end of the A4005EVR nozzle. Both o-rings must be properly secured inside the factory machined grooves.

Pre-Functional Test:

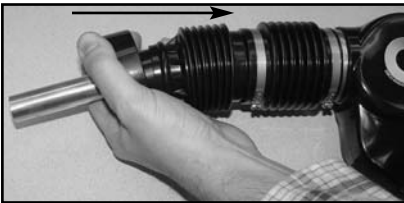


4. Functional test the insertion interlock of the A4005EVR nozzle by compressing the bellows and then squeezing the lever. The A4005EVR nozzle will not function unless the insertion interlock is properly engaged.

Pre-Installation:



5. Lightly lubricate both fuel path o-rings using petroleum jelly or other suitable lubricant.

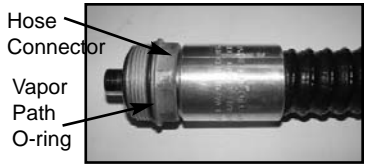

6. Before attempting to install the A4005EVR nozzle onto the A4110EVR hose swivel or curb hose, verify the vapor path o-ring is properly secured onto the swivel nut or hose connector. The vapor path o-ring must be in good working condition. Lightly lubricate the o-ring using petroleum jelly or other suitable lubricant.

IMPORTANT: Do not use pipe thread sealant compound or Teflon tape when installing the A4005EVR nozzle. Failure to comply will void warranty.


IMPORTANT: The A4110EVR hose swivel is only approved for use with the EMCO Wheaton Balance Phase II EVR System California Air Resources Board Executive Orders VR-207 and VR-208.

Installation:

IMPORTANT: If this is a new facility installation, the fueling point must be flushed into a gasoline approved container before installing the A4005EVR nozzle. Failure to perform this procedure could result in foreign material becoming lodged inside the nozzle's fuel path causing it not to shut off or a reduction in fuel flow.



7. Attach the A4005EVR nozzle onto the swivel nut or hose connector. Tighten by hand to avoid cross threading. Take caution to avoid pinching the vapor path o-ring.

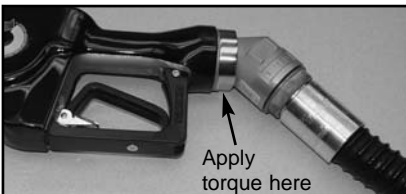

8. Using a 2" crows foot and torque wrench, tighten the swivel nut to 50 ft-lbs of torque. Using a 1 7/8" crows foot and torque wrench, tighten the hose connector to 50 ft-lbs of torque.

Post Functional Tests:

9. Carefully purge the trapped air from the fueling point. Begin dispensing by compressing the bellows and then squeezing the lever. Dispense one gallon of fuel into a gasoline approved container.
10. Functional test the automatic shutoff of the A4005EVR nozzle. Begin dispensing by compressing the bellows and then squeezing the lever. Place the hold-open latch in "high" clip position to secure the lever. Dispense one gallon of fuel into a gasoline approved container. At the same time, lower the spout tip into the standing fuel until the vent hole is completely submersed. The main valve of the A4005EVR nozzle will automatically close causing fuel flow to stop.

IMPORTANT: Perform step 10 a minimum of three times to assure the insertion interlock, hold open latch and the automatic shutoff of the A4005EVR nozzle are operating properly.

According to UL requirement 842, the fuel flow rate must be greater than 3 gallons per minute for the automatic shutoff to operate properly. A common cause of low flow rates are dirty or clogged dispenser filters.

Post Inspection:

11. Before placing the A4005EVR nozzle onto the dispenser cradle, inspect all hanging hardware connections for potential fuel leaks. Make proper adjustments if necessary.

PREVENTIVE MAINTENANCE

1. Weekly inspect the A4005EVR nozzle, evaluate the following components for damage: scuff guard, lever guard, lever, hold open latch, serial number plate, security rivet, bellows, band clamps, boot face and spout. Damage components must be replaced with factory authorized service kits.

<u>Part Number</u>	<u>Description</u>
492775EVR	Bellows & Boot Face Kit
492776EVR	Boot Face Kit
492834EVR	Spout Kit
494150EVR	Latch Kit
494748EVR	Fuel Path O-ring Kit
494750EVR	Bellows Band Clamps Kit
A0557EVR-XXX	Scuff Guard Kit

IMPORTANT: Do not remove the serial number plate and security rivet from the A4005EVR nozzle. Failure to comply will void warranty.

2. Weekly inspect the automatic shutoff located at the end of the spout. The vent hole must be free and clear of all debris.
3. Weekly inspect all hanging hardware connections for potential fuel leaks.

IMPORTANT: Should a drive-off or incidence of customer abuse occur, follow the initial inspection and function instructions found in the installation section.

PERFORMANCE STANDARDS & SPECIFICATIONS

This component was factory tested to, and met the following specifications:

1. Meets ARB Material Compatibility with Fuel Blends as per Section 3.8 of CP-201.
2. Meets ARB Capable of Refueling Any Vehicle Standards as per Section 4.7.1 of CP-201.
3. Meets ARB Spout Dimension Standards as per Section 4.7.3 of CP-201.
4. Meets ARB Nozzle and Dispenser Compatibility Standards as per Section 4.9 of CP-201.
5. Meets ARB Balance Nozzle Criteria Standards as per Section 5.1 of CP-201.
6. TP-201.2B – Complies with the maximum allowable leak rate of 0.07 CFH @ 2.00 inches of water column pressure.
7. TP-201.2C – Complies with the maximum allowable spillage factor of 0.24 pounds/ 1,000 gallons.
8. TP-201.2D – Complies with the maximum allowable average of 3 post fuel drips.
9. TP-201.2E – Complies with the maximum allowable average of 100mL liquid retention and 1mL liquid spit-back.
10. TP-201.2J – Complies with the maximum allowable component pressure drop of 0.08 inches of water column @ 60 CFH.

IMPORTANT: Leave these installation instructions with the station owner and/or operator.

IMPORTANT: Leave these installation instructions, product warranty registration card and the warranty tag with the station owner and/or operator.

Emco Wheaton Retail Corp.

2300 Industrial Park Dr. • Wilson, NC 27893
252-243-0150 • 252-243-4759 (fax)

p/n 569044
Rev. G, 03/13